


**LEXINGTON ELECTRIC SYSTEM**  
RESIDENTIAL OVERHEAD SERVICE  
WEATHERHEAD BELOW ROOF  
GENERAL ARRANGEMENT

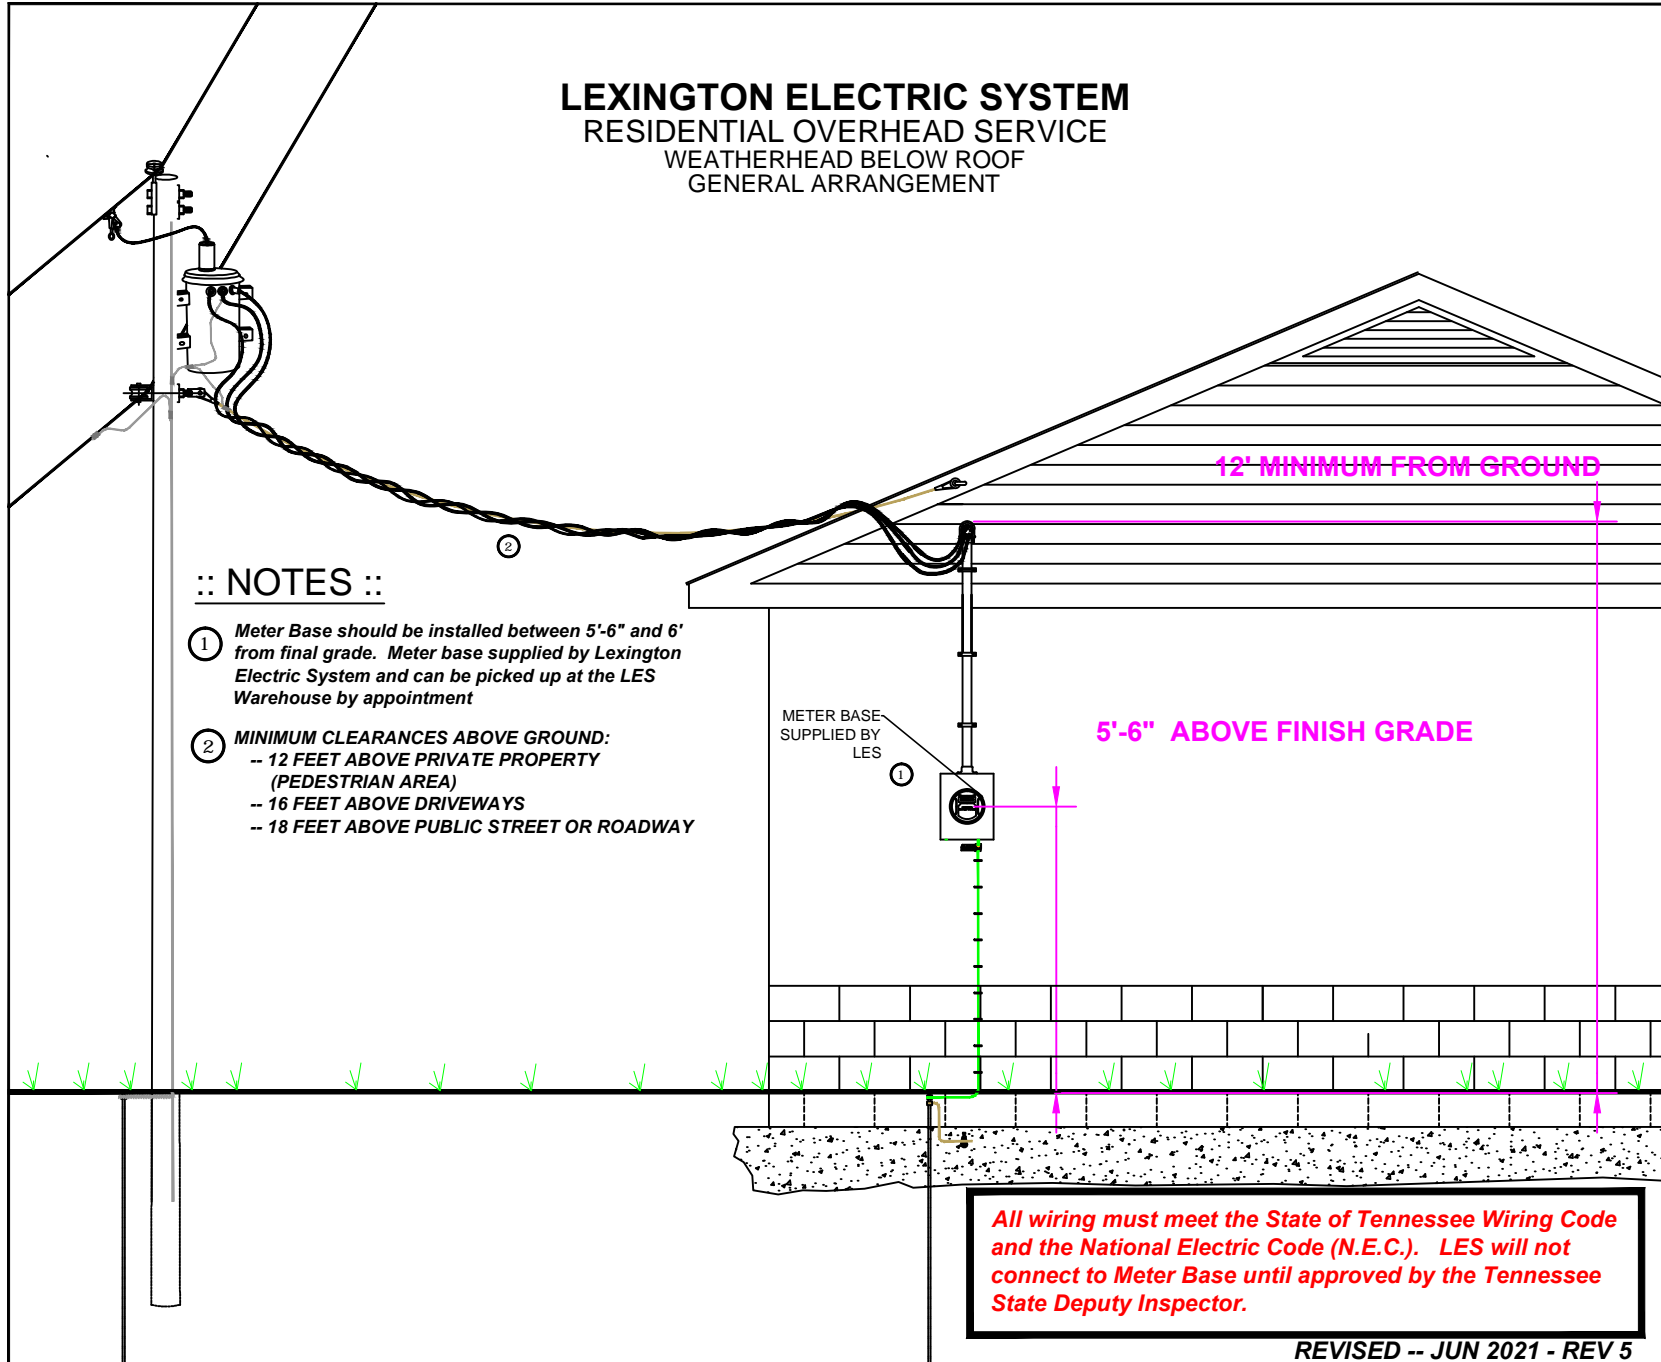

**:: NOTES ::**

- ① Meter Base should be installed between 5'-6" and 6' from final grade. Meter base supplied by Lexington Electric System and can be picked up at the LES Warehouse by appointment
- ② MINIMUM CLEARANCES ABOVE GROUND:
  - 12 FEET ABOVE PRIVATE PROPERTY (PEDESTRIAN AREA)
  - 16 FEET ABOVE DRIVEWAYS
  - 18 FEET ABOVE PUBLIC STREET OR ROADWAY

12' MINIMUM FROM GROUND

5'-6" ABOVE FINISH GRADE

**All wiring must meet the State of Tennessee Wiring Code and the National Electric Code (N.E.C.). LES will not connect to Meter Base until approved by the Tennessee State Deputy Inspector.**

REVISED -- JUN 2021 - REV 5